


CITY OF MONROE
NATURAL GAS METER SET
REQUIREMENTS

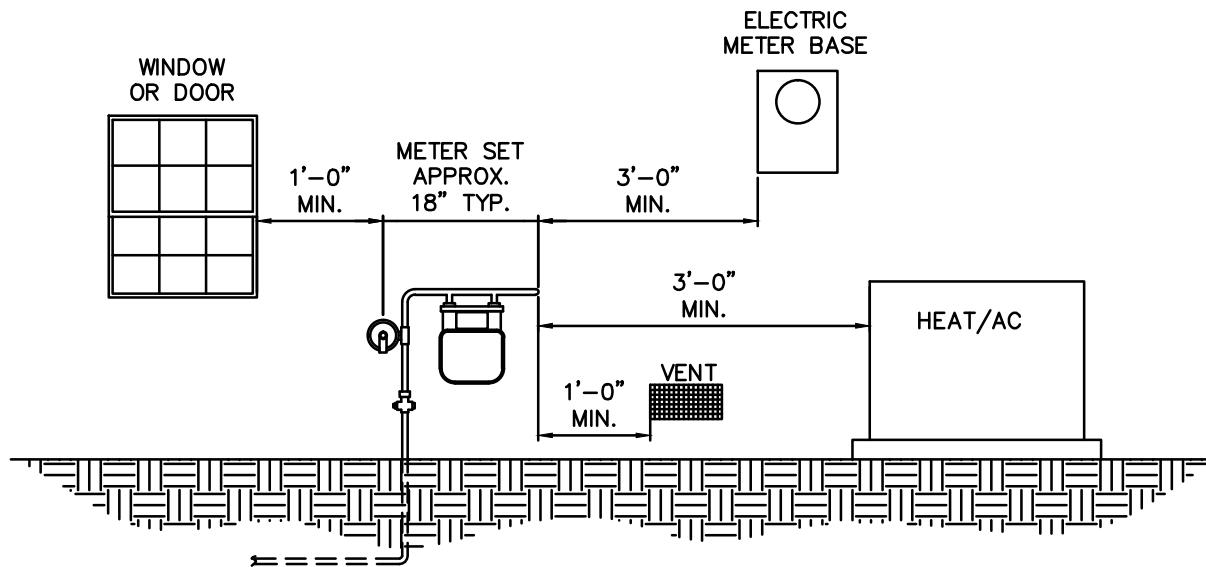

NOTES:

1. METER SET SHALL BE LOCATED AT LEAST 3'-0" FROM ANY SOURCE OF IGNITION.
2. METER SET SHALL NOT BE PLACED UNDER A WINDOW.
3. THERE SHALL A MINIMUM OF 1'-0" BETWEEN A CRAWL SPACE VENT AND METER SET.
4. IF METER SET IS LOCATED CLOSER THAN 1'-0" TO A VENT. THEN VENT MUST BE PERMANENTLY SEALED OFF.
5. NON-VENTED HEATERS USED AS THE ONLY SOURCE OF HEAT WILL NOT BE CONSIDERED.
6. METER SET WILL NOT BE INSTALL BEHIND A RESIDENTIAL STRUCTURE.